



BIO-CENTER LABORATORY

3100 N. Hillside, Wichita, KS 67219
 (316) 684-7784 Fax (316) 682-2062

CLIA #: 17D0648333
 Medicare #: 008052

CYTOTOXIC STANDARD LIST #1

0 - No adverse reaction (No visible bar)

1 - Mild reaction


2 - Moderate reaction

Control (Negative): Good

3 - Moderately severe reaction

4 - Severe reaction

Control (Positive): 3

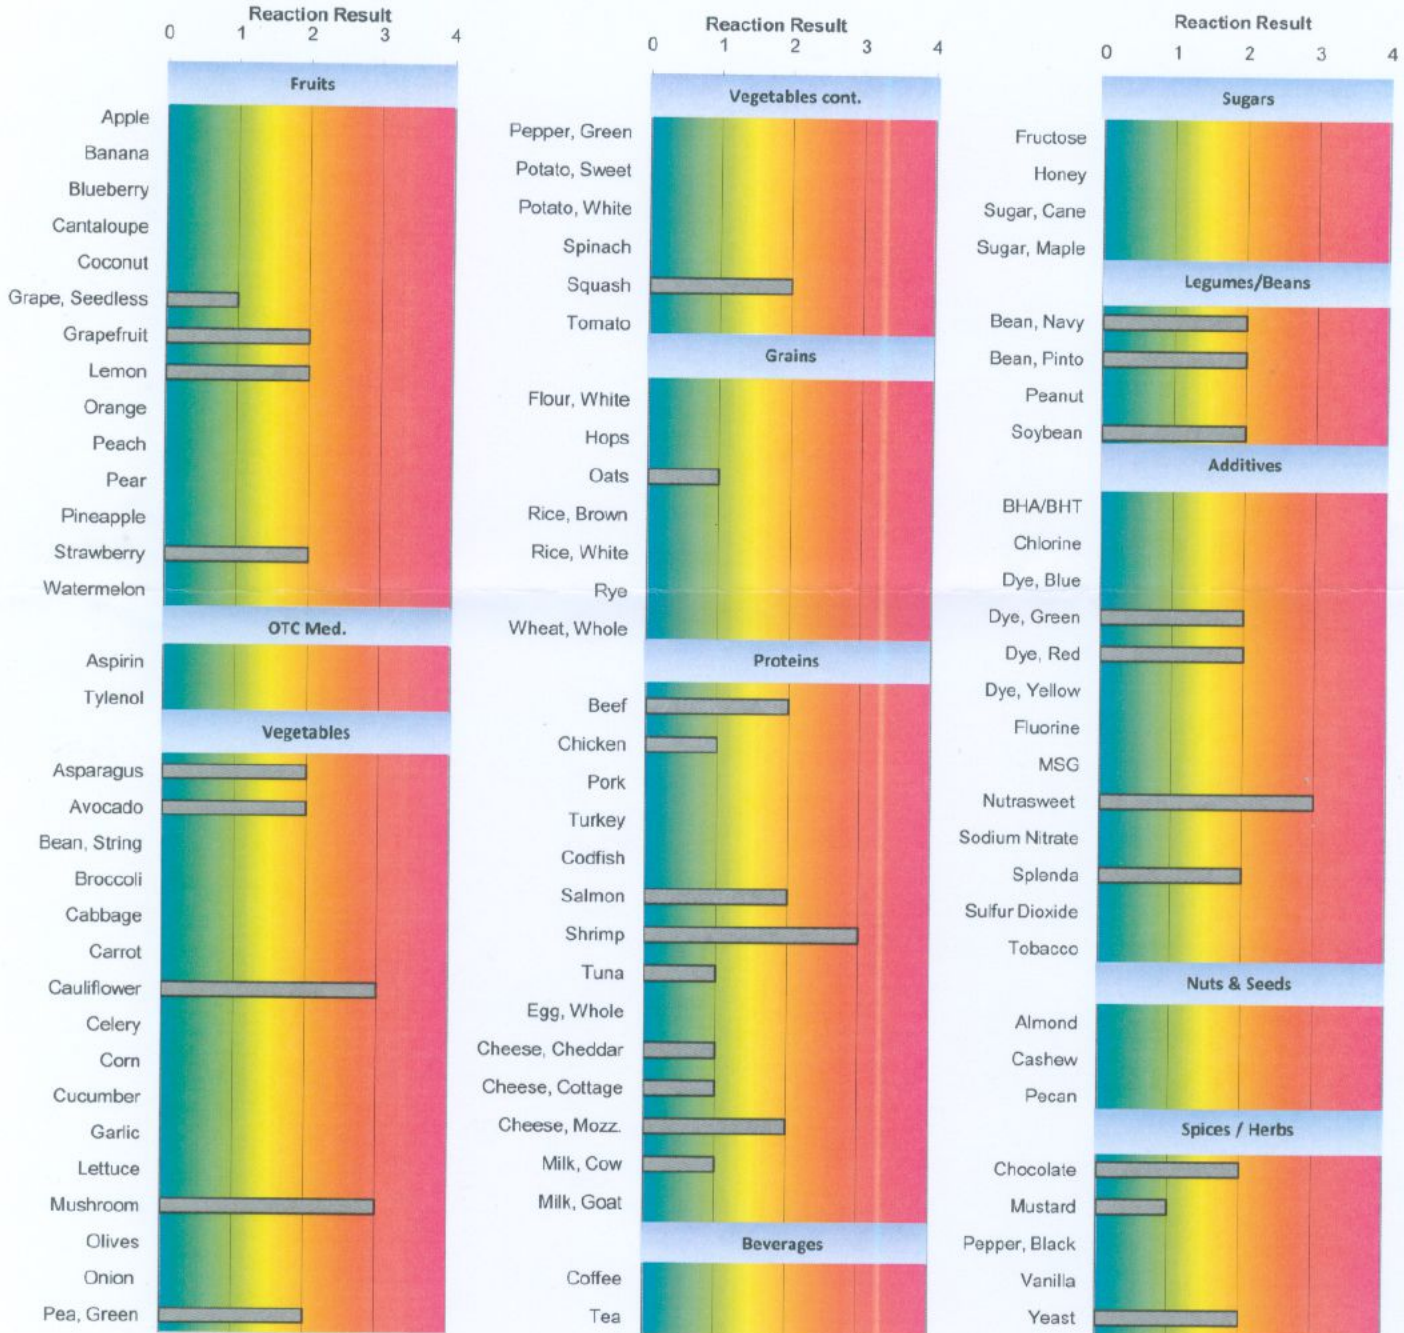

Name: Barnett, Jonathan
 Physician: Dr. Ronald Hunninghake

Accession/Chart No: 121583/018283
 Tech: KM

Collected: 12/14/10 1200
 Date/Time: 12/14/10 1600